
BIOFUEL BURNER SYSTEM TYPE TW 1

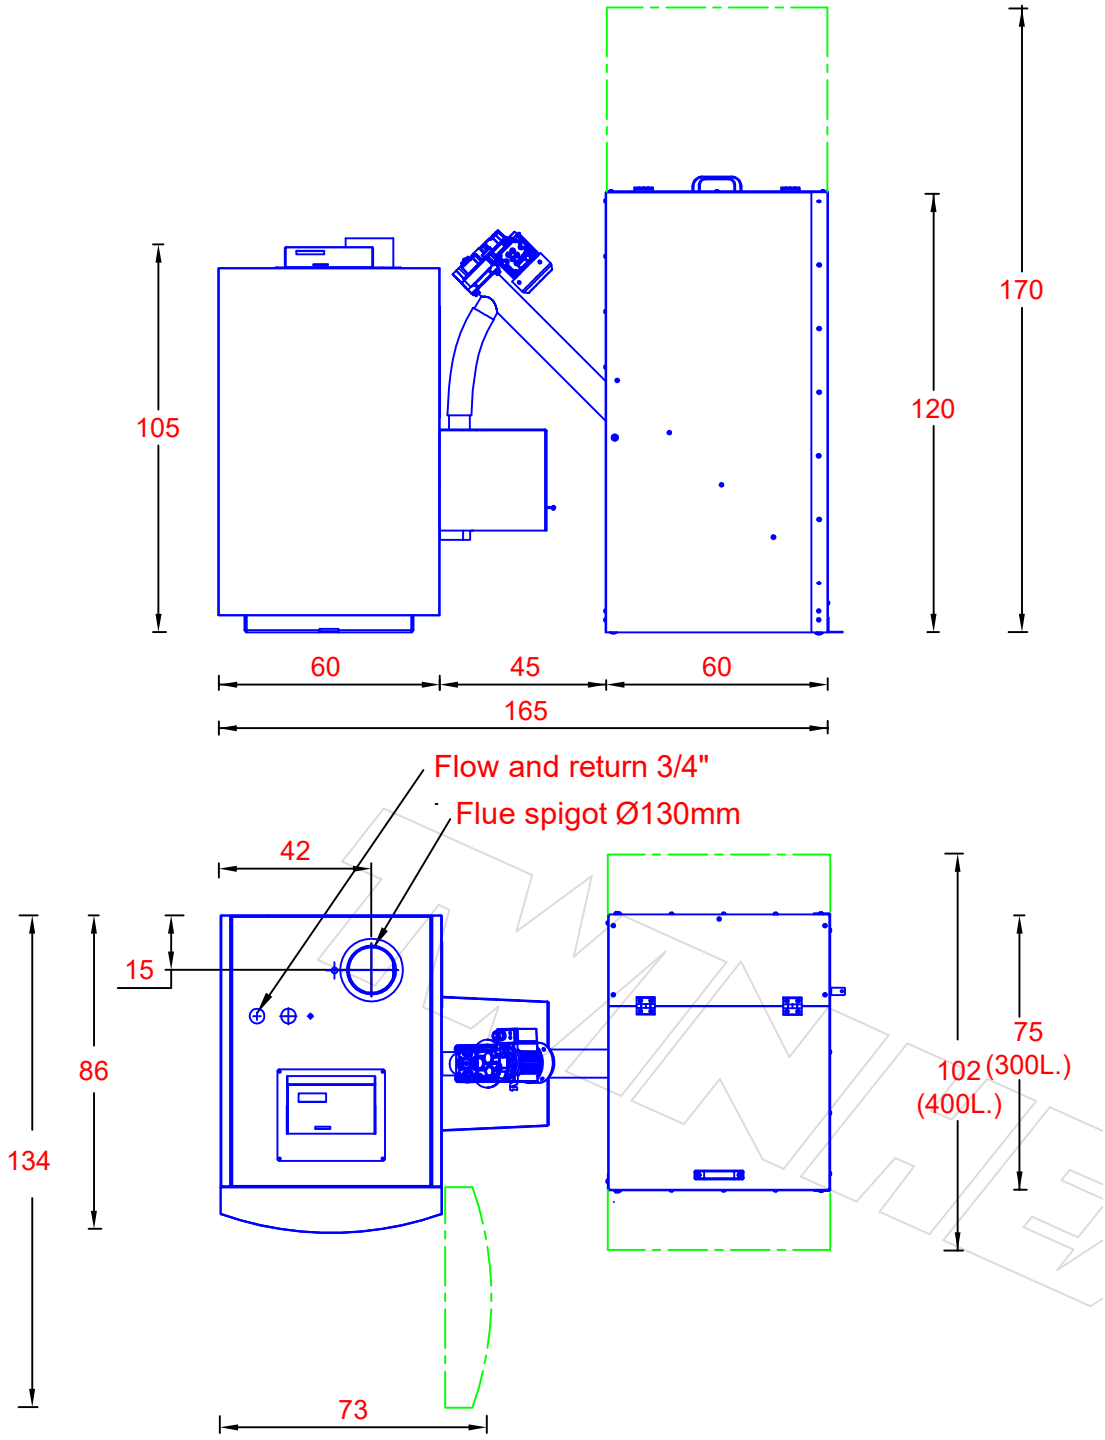

Measurement results

Testing according to EN 303-5:2012 w ith requirements pursuant to Executive Order no. 49 of 16/01/2018

Measurement	Unit	TW-1	Requirements
Nominal output	KW	12,7	
CO at 10% 02	mg/mn3	70	500
OGC at 10% 02	mg/mn3	<6	20
Dust at 10% O2	mg/mn3	32	40
Efficiency	%	92,9	88,1
Lowest payment	KW	3,7	
Efficiency	%	90,5	87,6

Twin Heat A/S • Nørrevangen 7 • 9631 Gedsted
Phone: +45 98645222
Mail: twinheat@twinheat.dk • www.twinheat.dk

We reserve the rights to make changes - May 2026